




U-槽天花系統(重型) Data Centre Metal Ceiling (Heavy)



數據中心U槽天花安裝

數據中心U槽天花頂層安裝實況

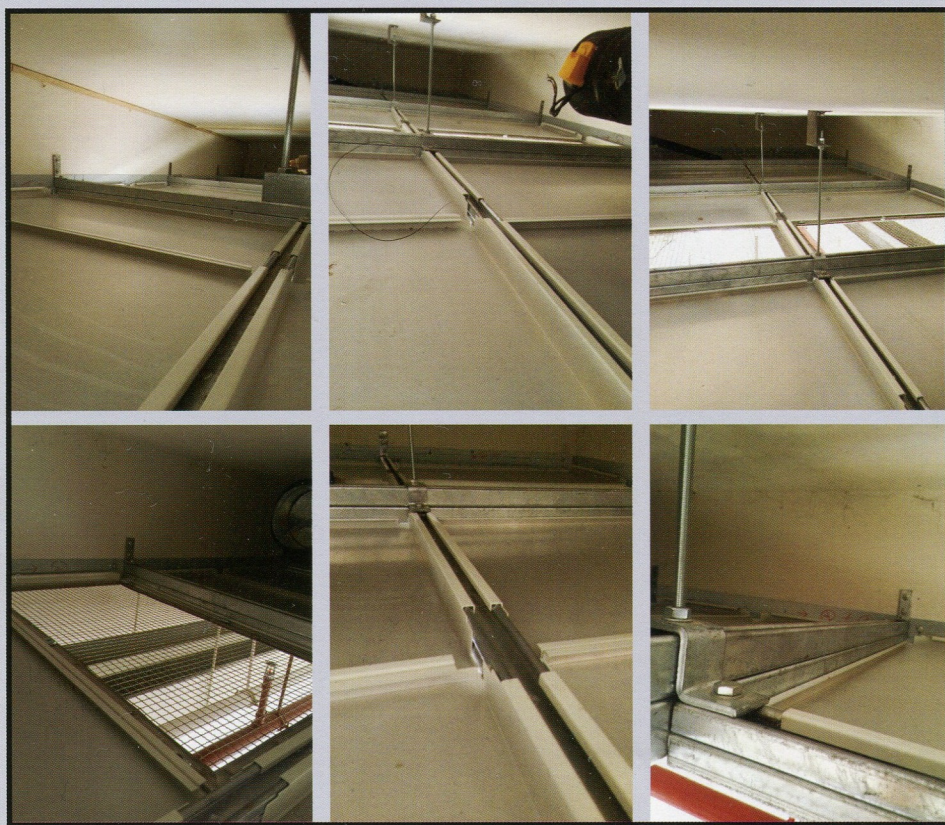




U-槽 U-Channel

62SH 41SH 21SH




生產商	東莞漫亞
產品名	U槽
物料	2.5/43A 金屬板
B.S.標準	BS729
接駁方法	焊接
誤差	± 0.8mm

21SN 41SN 62SN

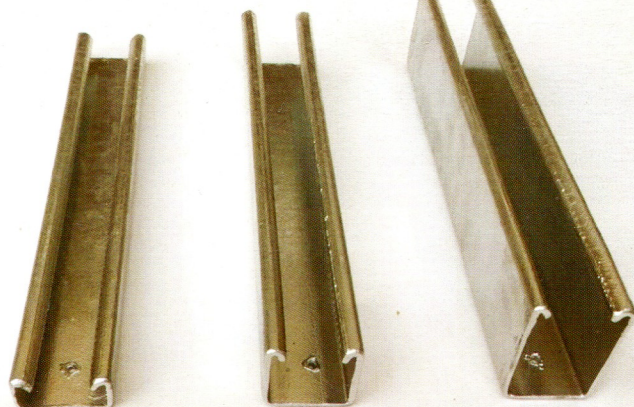

生產商	東莞漫亞
產品名	U槽
物料	2.5/43A 金屬板
B.S.標準	BS729
接駁方法	焊接
誤差	± 0.8mm

21DN 41DN 62DN(21) 62DN

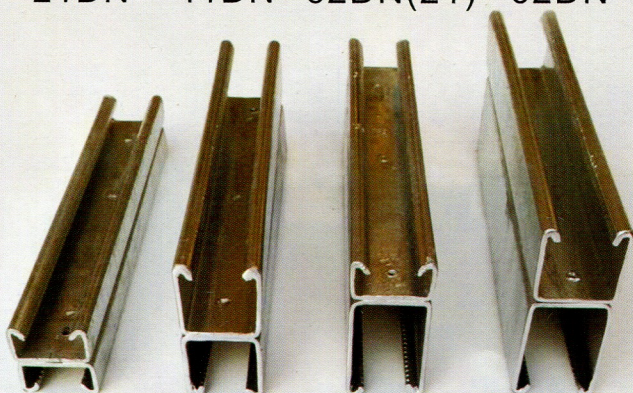


生產商	東莞漫亞
產品名	U槽
物料	2.5/43A 金屬板
B.S.標準	BS729
接駁方法	焊接
誤差	± 0.8mm



東莞漫亞
五金製品有限公司
Dongguan Manya
Hardware Products Company Limited



U-槽配件 U-Channel Parts

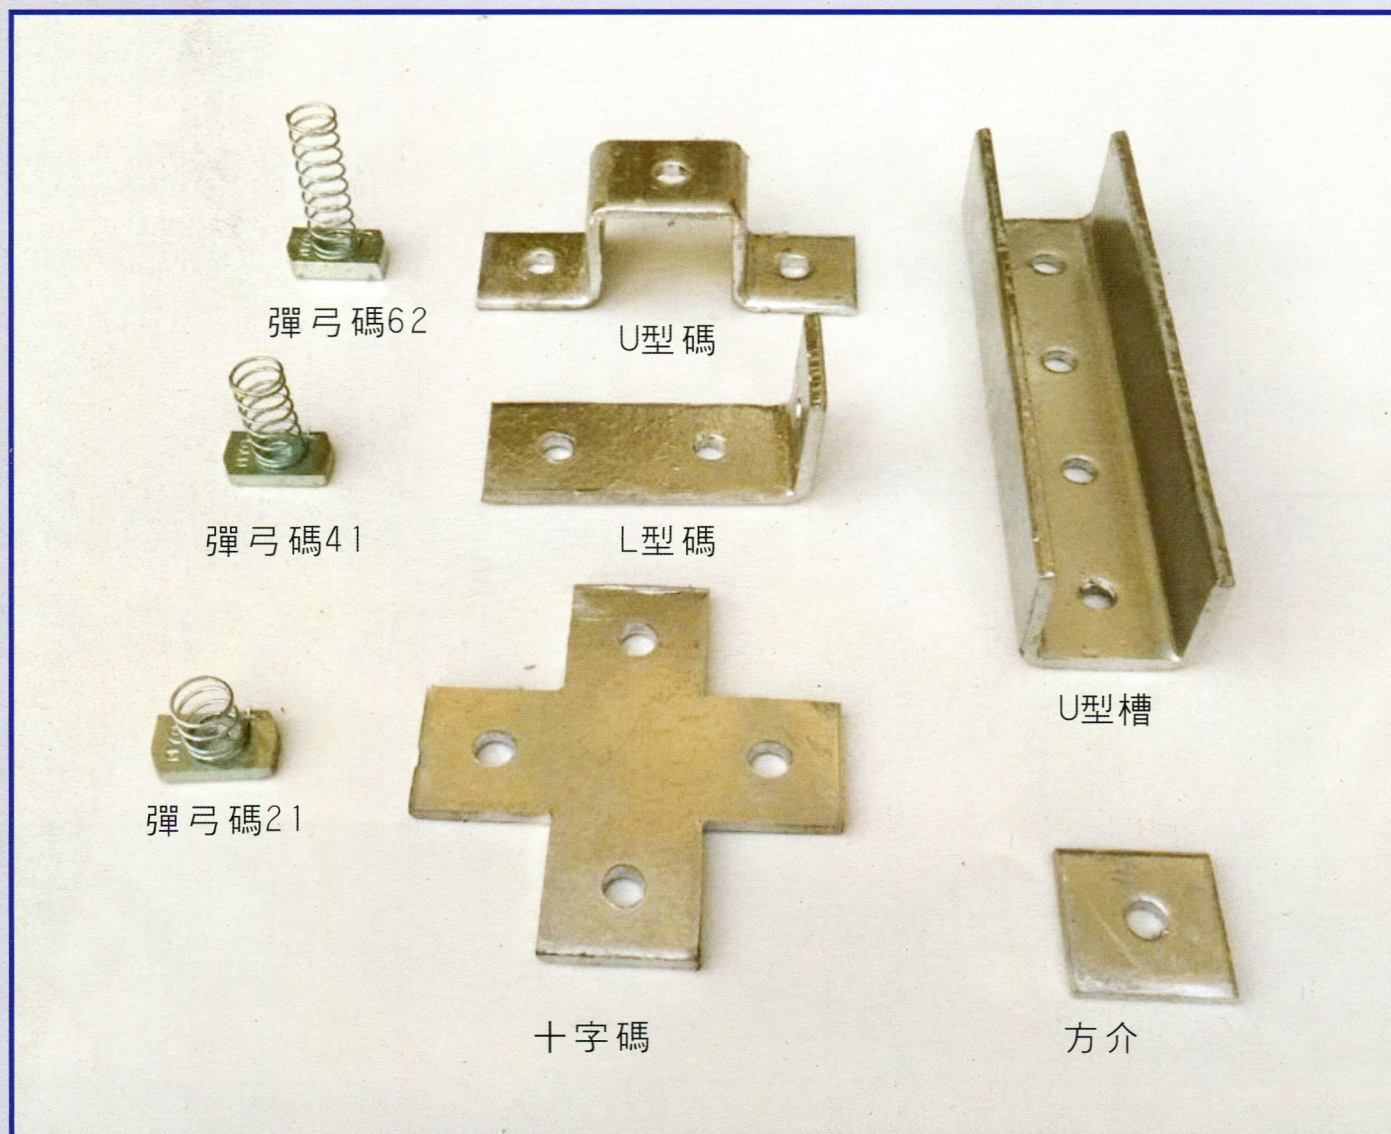

漫亞產品編號		標準呎碼
		螺絲母
Ns-06	Ss-06	6mm
Ns-08	Ss-08	8mm
Ns-10	Ss-10	10mm
Ns-12	Ss-12	12mm

生產商	東莞漫亞
產品名	U槽配件
物料	2.5/43A 金屬板
B.S.標準	BS729
接駁方法	焊接
誤差	± 0.8mm



U-槽測試報告

MYG-21SH

TEST REPORT Page 1 of 4

Date: 2004-11-22
No: HC155827

Applicant Code: MY001

Applicant: Manya Steel Products manufactory
Langsha Industrial Zone
Qiongzhu Town
Dongguan City
Guangdong Province PRC

Description of Samples: One submitted sample said to be M.Y.G. 21SH 21 x 41 mm "U" Channel

Date Samples Received: 2004-09-31

Date Tested: 2004-09-01 to 2004-09-15

Investigation Requested:

1. Slip Load Test of M10 Grade 4.6 steel bolt
2. Pull Out Test of M10 Grade 4.6 steel bolt

Method(s) Used: BS 6945: 1988 (Refer to Appendix for the test set-up)

Signature: Anne Chuan, CPO For Chief Executive

The report shall not be reproduced unless with prior written approval from the Hong Kong Standards and Testing Centre.

香港標準及檢定中心
10 Die Wang Street, Taiipo Industrial Estate, N. T., Hong Kong
Tel: (852) 2968 1888 Fax: (852) 2964 4353 Homepage: www.hkstdc.org E-mail: hkstdc@hkstdc.org
For full text of "Conditions of Issuance of Test Reports", please refer to website or refer to the website of
STC: www.hkstdc.org (the section "Application and Quotation")

MYG-41SH

TEST REPORT Page 1 of 4

Date: 2004-11-22
No: HC155827

Applicant Code: MY001

Applicant: Manya Steel Products manufactory
Langsha Industrial Zone
Qiongzhu Town
Dongguan City
Guangdong Province PRC

Description of Samples: One submitted sample said to be M.Y.G. 41SH 41 x 41 mm "U" Shape Framing Channel

Date Samples Received: 2004-09-03 and 2004-09-13

Date Tested: 2004-09-01 to 2004-09-15

Investigation Requested:

1. Slip Load Test of M10 Grade 4.6 steel bolt
2. Pull Out Test of M10 Grade 4.6 steel bolt

Method(s) Used: BS 6945: 1988 (Refer to Appendix for the test set-up)

Signature: Anne Chuan, CPO For Chief Executive

The report shall not be reproduced unless with prior written approval from the Hong Kong Standards and Testing Centre.

香港標準及檢定中心
10 Die Wang Street, Taiipo Industrial Estate, N. T., Hong Kong
Tel: (852) 2968 1888 Fax: (852) 2964 4353 Homepage: www.hkstdc.org E-mail: hkstdc@hkstdc.org
For full text of "Conditions of Issuance of Test Reports", please refer to website or refer to the website of
STC: www.hkstdc.org (the section "Application and Quotation")

MYG-62SH

TEST REPORT Page 1 of 2

Date: 2004-09-22
No: HC155826

Applicant Code: MY001

Applicant: Manya Steel Products manufactory
Langsha Industrial Zone
Qiongzhu Town
Dongguan City
Guangdong Province PRC

Description of Samples: One submitted sample said to be M.Y.G. 62SH 62 x 41 mm "U" Shape Framing Channel

Date Samples Received: 2004-09-03 and 2004-09-13

Date Tested: 2004-09-01 to 2004-09-15

Investigation Requested:

1. Slip Load Test of M10 Grade 4.6 steel bolt
2. Pull Out Test of M10 Grade 4.6 steel bolt

Method(s) Used: BS 6945: 1988

Signature: Anne Chuan, CPO For Chief Executive

The report shall not be reproduced unless with prior written approval from the Hong Kong Standards and Testing Centre.

香港標準及檢定中心
10 Die Wang Street, Taiipo Industrial Estate, N. T., Hong Kong
Tel: (852) 2968 1888 Fax: (852) 2964 4353 Homepage: www.hkstdc.org E-mail: hkstdc@hkstdc.org
For full text of "Conditions of Issuance of Test Reports", please refer to website or refer to the website of
STC: www.hkstdc.org (the section "Application and Quotation")

測試附件1

TEST REPORT Page 4 of 4

Date: 2004-11-22
No: HC155827

Slip Load test of Galvanized steel channel with spring nut & steel bolt

Applied force from U.T.M.

Galvanized steel channel

Steel bolt

Spring nut

Fixture

***** End of Test Report *****

香港標準及檢定中心
10 Die Wang Street, Taiipo Industrial Estate, N. T., Hong Kong
Tel: (852) 2968 1888 Fax: (852) 2964 4353 Homepage: www.hkstdc.org E-mail: hkstdc@hkstdc.org
For full text of "Conditions of Issuance of Test Reports", please refer to website or refer to the website of
STC: www.hkstdc.org (the section "Application and Quotation")

測試附件2

TEST REPORT Page 3 of 4

Date: 2004-11-22
No: HC155827

Pull Out test of Galvanized steel channel with spring nut & steel bolt

Applied Force from U.T.M.

Grip in U.T.M.

Spring nut

Steel Bolt

Galvanized steel channel

Fixture

Grip


Applied Force from U.T.M.

香港標準及檢定中心
10 Die Wang Street, Taiipo Industrial Estate, N. T., Hong Kong
Tel: (852) 2968 1888 Fax: (852) 2964 4353 Homepage: www.hkstdc.org E-mail: hkstdc@hkstdc.org
For full text of "Conditions of Issuance of Test Reports", please refer to website or refer to the website of
STC: www.hkstdc.org (the section "Application and Quotation")




U-槽

MYG-41SH

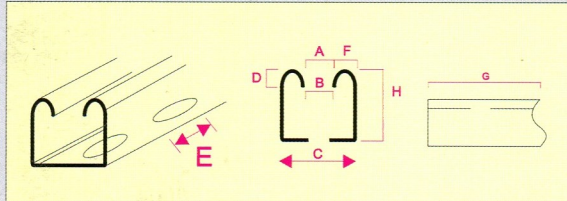


型號	物料		軟鐵厚度		鋅塗層質量		長度	
MYG41SH	43A		2.5mm		Not Less than 41μm		6m	
標示	A	B	C	D	E	F	G	H
呎碼	21mm	15mm	41mm	7mm	29mm	10mm	6m	41mm

MYG-41DH

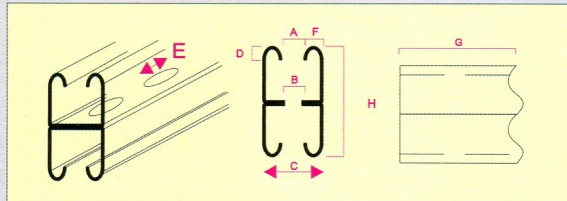


型號	物料		軟鐵厚度		鋅塗層質量		長度	
MYG41DH	43A		2.5mm		Not Less than 41μm		6m	
標示	A	B	C	D	E	F	G	H
呎碼	21mm	15mm	41mm	7mm	29mm	10mm	6m	82mm

MYG-41SN

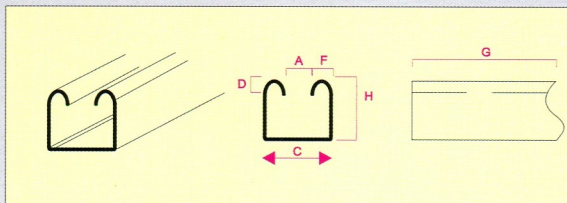


型號	物料		軟鐵厚度		鋅塗層質量	長度		
MYG41SN	43A		2.5mm		Not Less than 41μm	6m		
標示	A	B	C	D	E	F	G	H
呎碼	21mm		41mm	7mm		10mm	6m	41mm

MYG-41DN

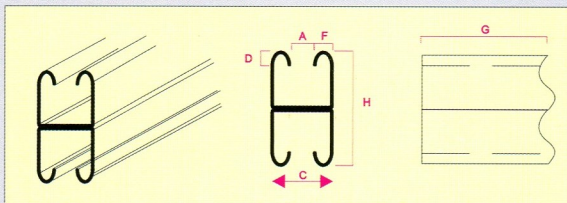

型號	物料		軟鐵厚度		鋅塗層質量		長度	
MYG41DN	43A		2.5mm		Not Less than 41μm		6m	
標示	A	B	C	D	E	F	G	H
呎碼	21mm		41mm	7mm		10mm	6m	82mm

U-Channel

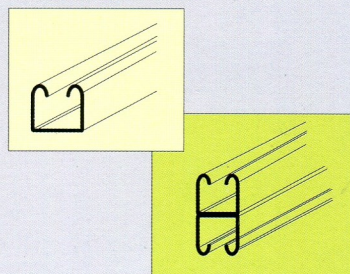


生產商	MYG
產品名	U-Channel / U 槽
物料	2.5/43A 金屬板
B.S.標準	BS 729
接駁方法	焊接
誤差	±0.8mm




U-槽

MYG-62SH

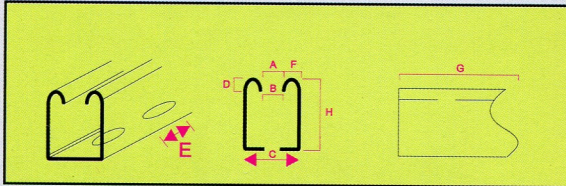


型號	物料		軟鐵厚度		鋅塗層質量		長度	
MYG62SH	43A		2.5mm		Not Less than 41μm		6m	
標示	A	B	C	D	E	F	G	H
呎碼	21mm	15mm	41mm	7mm	29mm	10mm	6m	62mm

MYG-62DH

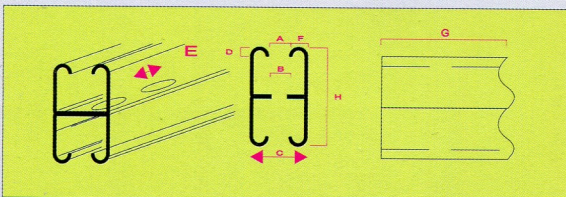


型號	物料		軟鐵厚度		鋅塗層質量		長度	
MYG62DH	43A		2.5mm		Not Less than 41μm		6m	
標示	A	B	C	D	E	F	G	H
呎碼	21mm	15mm	41mm	7mm	29mm	10mm	6m	124mm

MYG-62SN

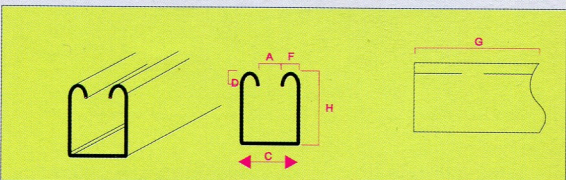


型號	物料		軟鐵厚度		鋅塗層質量	長度		
MYG62SN	43A		2.5mm		Not Less than 41μm	6m		
標示	A	B	C	D	E	F	G	H
呎碼	21mm		41mm	7mm		10mm	6m	62mm

MYG-62DN

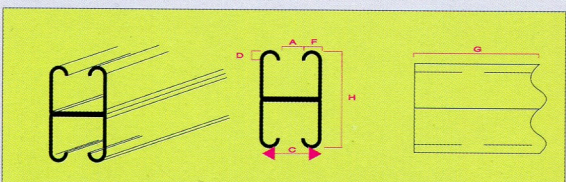

型號	物料		軟鐵厚度		鋅塗層質量		長度	
MYG62DN	43A		2.5mm		Not Less than 41μm		6m	
標示	A	B	C	D	E	F	G	H
呎碼	21mm		41mm	7mm		10mm	6m	124mm

U-Channel

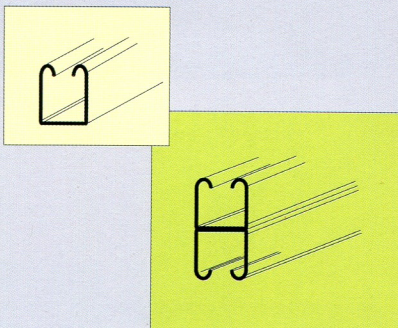

生產商	MYG
產品名	U-Channel / U 槽
物料	2.5/43A 金屬板
B.S.標準	BS 729
接駁方法	焊接
誤差	±0.8mm